

# Drawings

EJX110A

Differential Pressure Transmitter


Wetted Parts Material Code: H, M, T, A, B, D

DP **harp** EJX™


[Style: S3]

● Vertical Impulse Piping Type (Installation code 7)

Unit: mm(approx. inch)

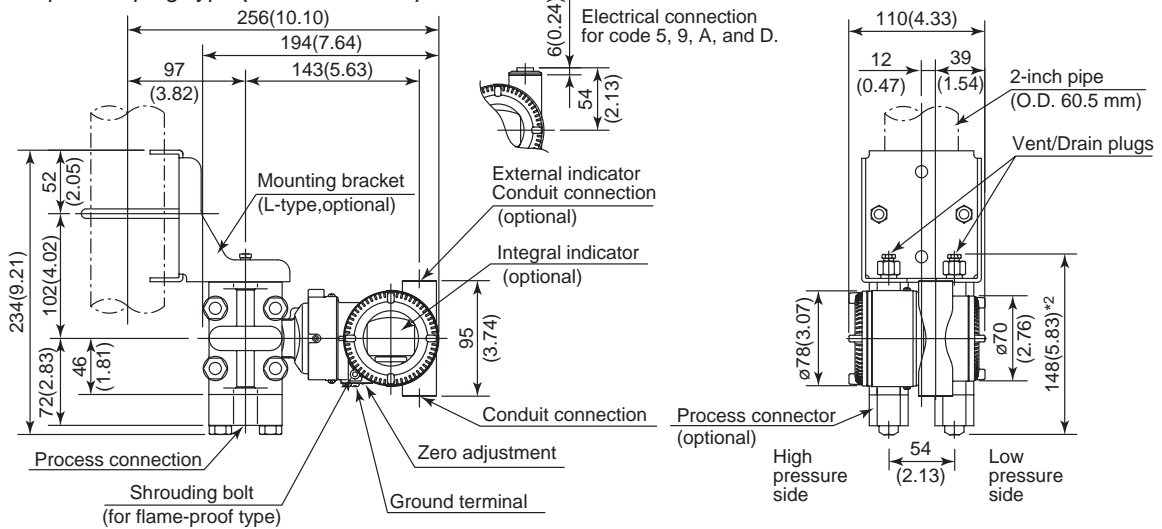


● Horizontal Impulse Piping Type (Installation code 9)

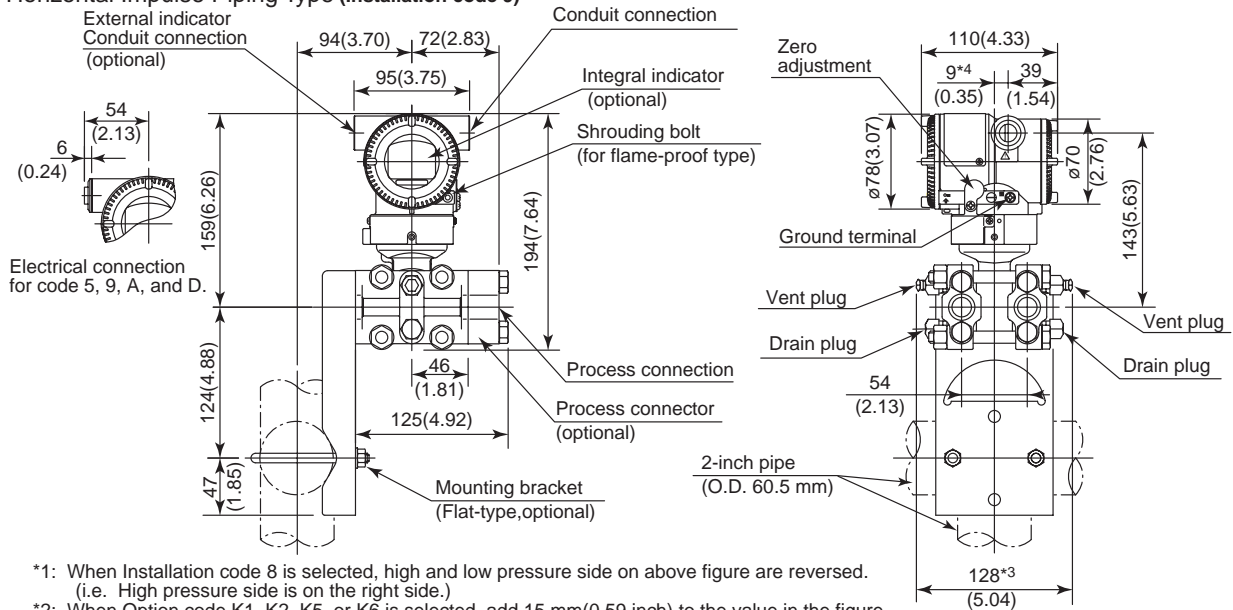

- \*1: When Installation code 8 is selected, high and low pressure side on above figure are reversed. (i.e. High pressure side is on the right side.)
- \*2: When Option code K1, K2, K5, or K6 is selected, add 15 mm(0.59 inch) to the value in the figure.
- \*3: When Option code K1, K2, K5, or K6 is selected, add 30 mm(1.18 inch) to the value in the figure.
- \*4: 15 mm(0.59 inch) for right side high pressure.

● Terminal Configuration

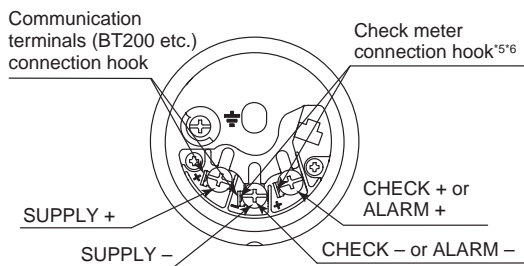

● Terminal Wiring

|                          |  |
|--------------------------|--|
| SUPPLY +                 | Power supply and output terminal   |
| CHECK +<br>or<br>ALARM + | External indicator (ammeter) terminal*5*6<br>or<br>Status contact output terminal*6<br>(when /AL is specified) |
| ⏏                        | Ground terminal  |

\*5: When using an external indicator or check meter, the internal resistance must be 10 Ω or less. A check meter or indicator cannot be connected when /AL option is specified.

\*6: Not available for fieldbus communication type.