



Unit: mm(approx. inch)

● Universal Flange (Installation code U)

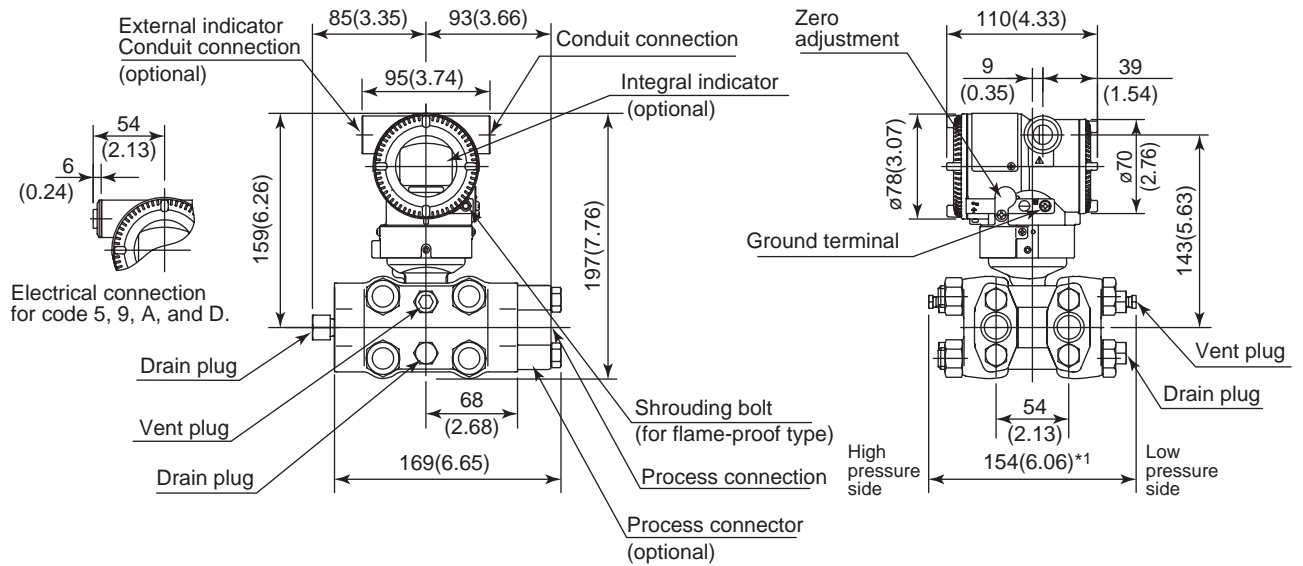

\*1: When Option code K1, K2, K5, or K6 is selected, add 30 mm(1.18 inch) to the value.

● Terminal Configuration

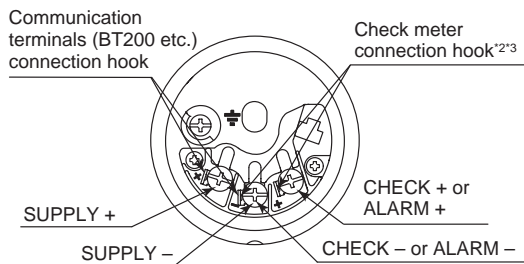

● Terminal Wiring

SUPPLY	+	Power supply and output terminal
CHECK	+	External indicator (ammeter) terminal <sup>2*3</sup>
or	-	
ALARM	+	Status contact output terminal <sup>3</sup> (when /AL is specified)
	-	
	⏏	Ground terminal

\*2: When using an external indicator or check meter, the internal resistance must be 10 Ω or less. A check meter or indicator cannot be connected when /AL option is specified.

\*3: Not available for fieldbus communication type.