


Unit: mm(approx. inch)

● Universal Flange (Installation code U)

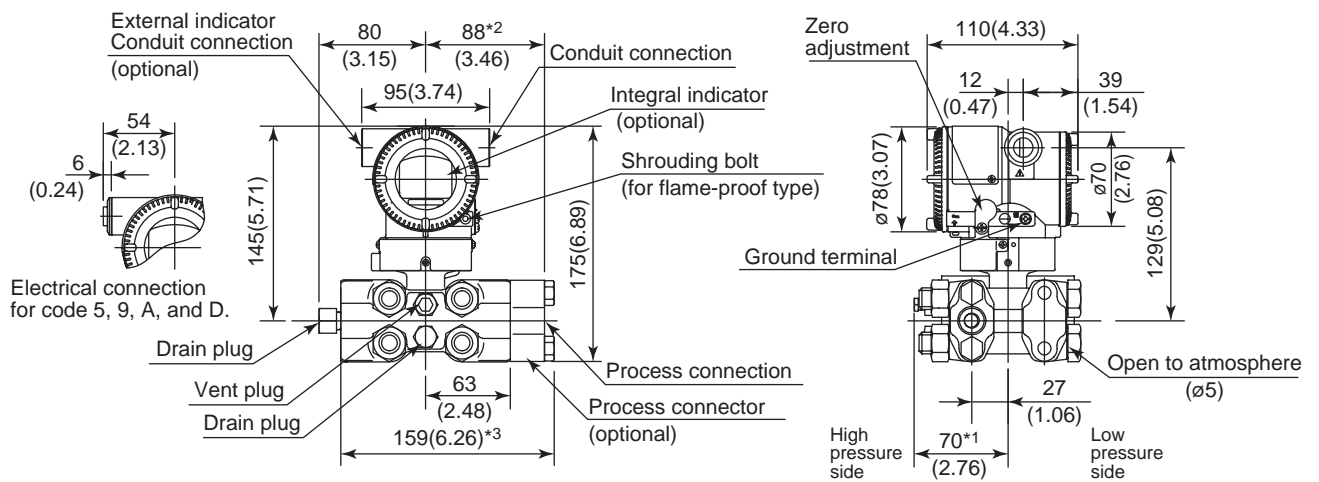


*1: When Option code K1, K2, K5, or K6 is selected, add 15 mm(0.59 inch) to the value.

*2: 87 mm(3.43 inch) for capsule code D.

*3: 157 mm(6.18 inch) for capsule code D.

● Terminal Configuration

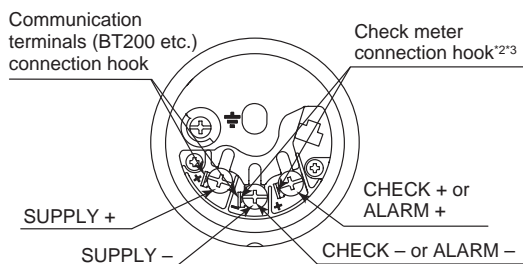

● Terminal Wiring

SUPPLY	+	Power supply and output terminal
CHECK	+	External indicator (ammeter) terminal ^{2*3}
or	-	
ALARM	+	Status contact output terminal ³ (when /AL is specified)
	-	
	⏏	Ground terminal

*2: When using an external indicator or check meter, the internal resistance must be 10 Ω or less. A check meter or indicator cannot be connected when /AL option is specified.

*3: Not available for fieldbus communication type.