


● Terminal Configuration

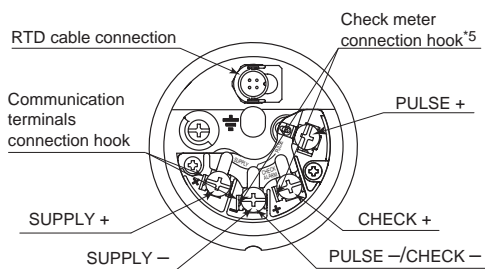

● Terminal Wiring

SUPPLY +	+	Power supply and output terminal
CHECK +	+	External indicator(ammeter) terminal ⁵
PULSE +	+	Pulse or status contact output terminal
	⊥	Ground terminal

*5: When using an external indicator or check meter, the internal resistance must be 10 Ω or less.